



Per UPC 1211.4 & CLV Ordinance

ABS or PVC Sleeve, min. 1/2 inch Larger than Gas Pipe

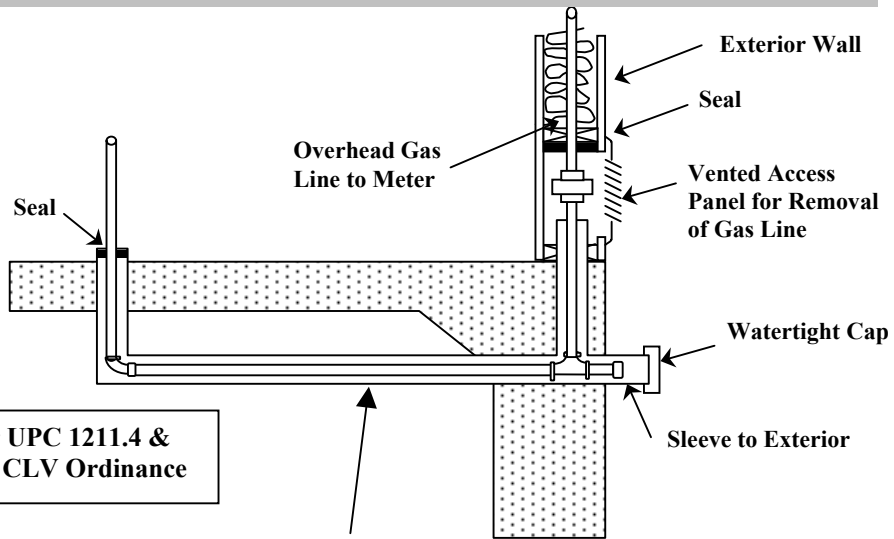

Per UPC 1211.4 & the CLV Ordinance

ABS or PVC Sleeve, min. 1/2 inch Larger than Gas Pipe

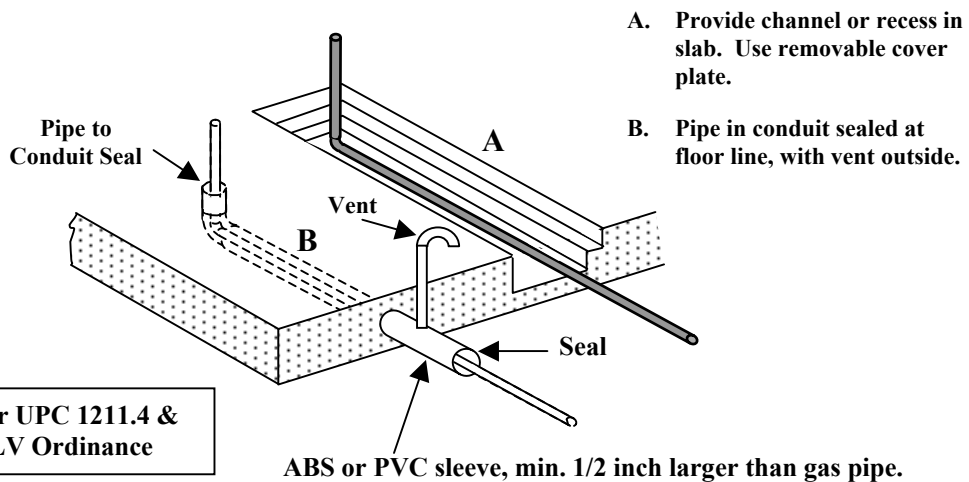

Per UPC 1211.4 & CLV Ordinance

A. Provide channel or recess in slab. Use removable cover plate.

B. Pipe in conduit sealed at floor line, with vent outside.

ABS or PVC sleeve, min. 1/2 inch larger than gas pipe.